


5/8" X 3/4" AND 1" WATER METER

NTS

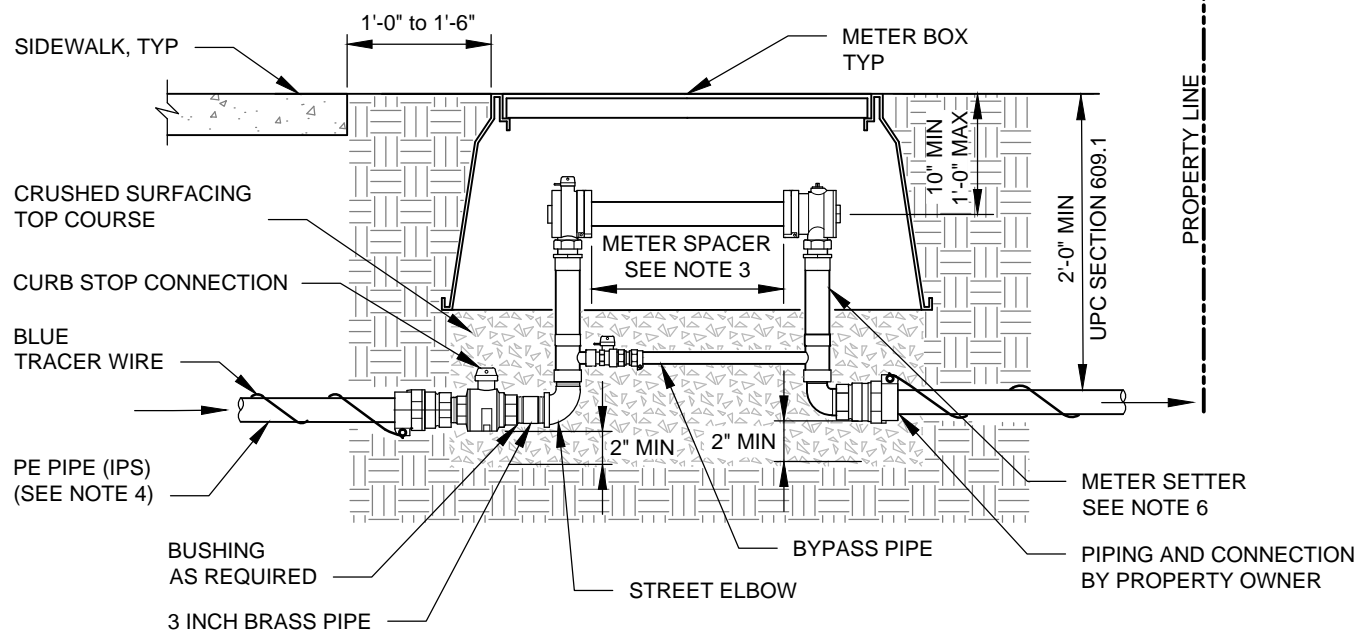

1- 1/2" AND 2" WATER METER

NTS

NOTES:

1. SEE STANDARD DETAIL 201A, 201C, 703, 703A, 703B AND 703C FOR ADDITIONAL DETAILS.
2. SET METER BOX FLUSH WITH SIDEWALK OR CURB ELEVATION IF LOCATED IN LAWN AREA.
SET METER BOX 2 INCHES ABOVE FINISHED GRADE IF LOCATED IN NON-LAWN AREA.
3. SPACER FOR A 1- 1/2 INCH METER IS 13- 1/4 INCHES IN LENGTH. SPACER FOR A 2 INCH METER IS 17- 1/4 INCHES IN LENGTH. SPACER PROVIDED BY CONTRACTOR.
4. SERVICE CONNECTION PIPE SIZE SHALL BE 2 INCH DIAMETER.
5. FOR 5/8 INCH X 3/4 INCH OR 1 INCH METER SETTERS, INSTALL A 3 INCH LONG BRASS PIPE BETWEEN THE BUSHING AND THE METER SETTER. DIAMETER SIZE OF BRASS PIPE TO MATCH METER SETTER SIZE.
6. 1- 1/2 INCH AND 2 INCH METER SETTERS MAY BE HORIZONTAL OR VERTICAL INLETS AND OUTLETS.
7. ALL FITTINGS SHALL BE BRASS.
8. TOUCHREAD PAD HOLE TO BE DRILLED BY CITY.

Scott Thomassen

APPROVED BY: SCOTT THOMASSON
WATER/WASTEWATER ENGINEERING MANAGER

REVISION DATE: MARCH 01, 2017



STANDARD DETAILS

5/8" X 3/4" TO 2"
METER SETTER DETAILS

FILE NAME: SD702.DWG

DETAIL NUMBER: 702